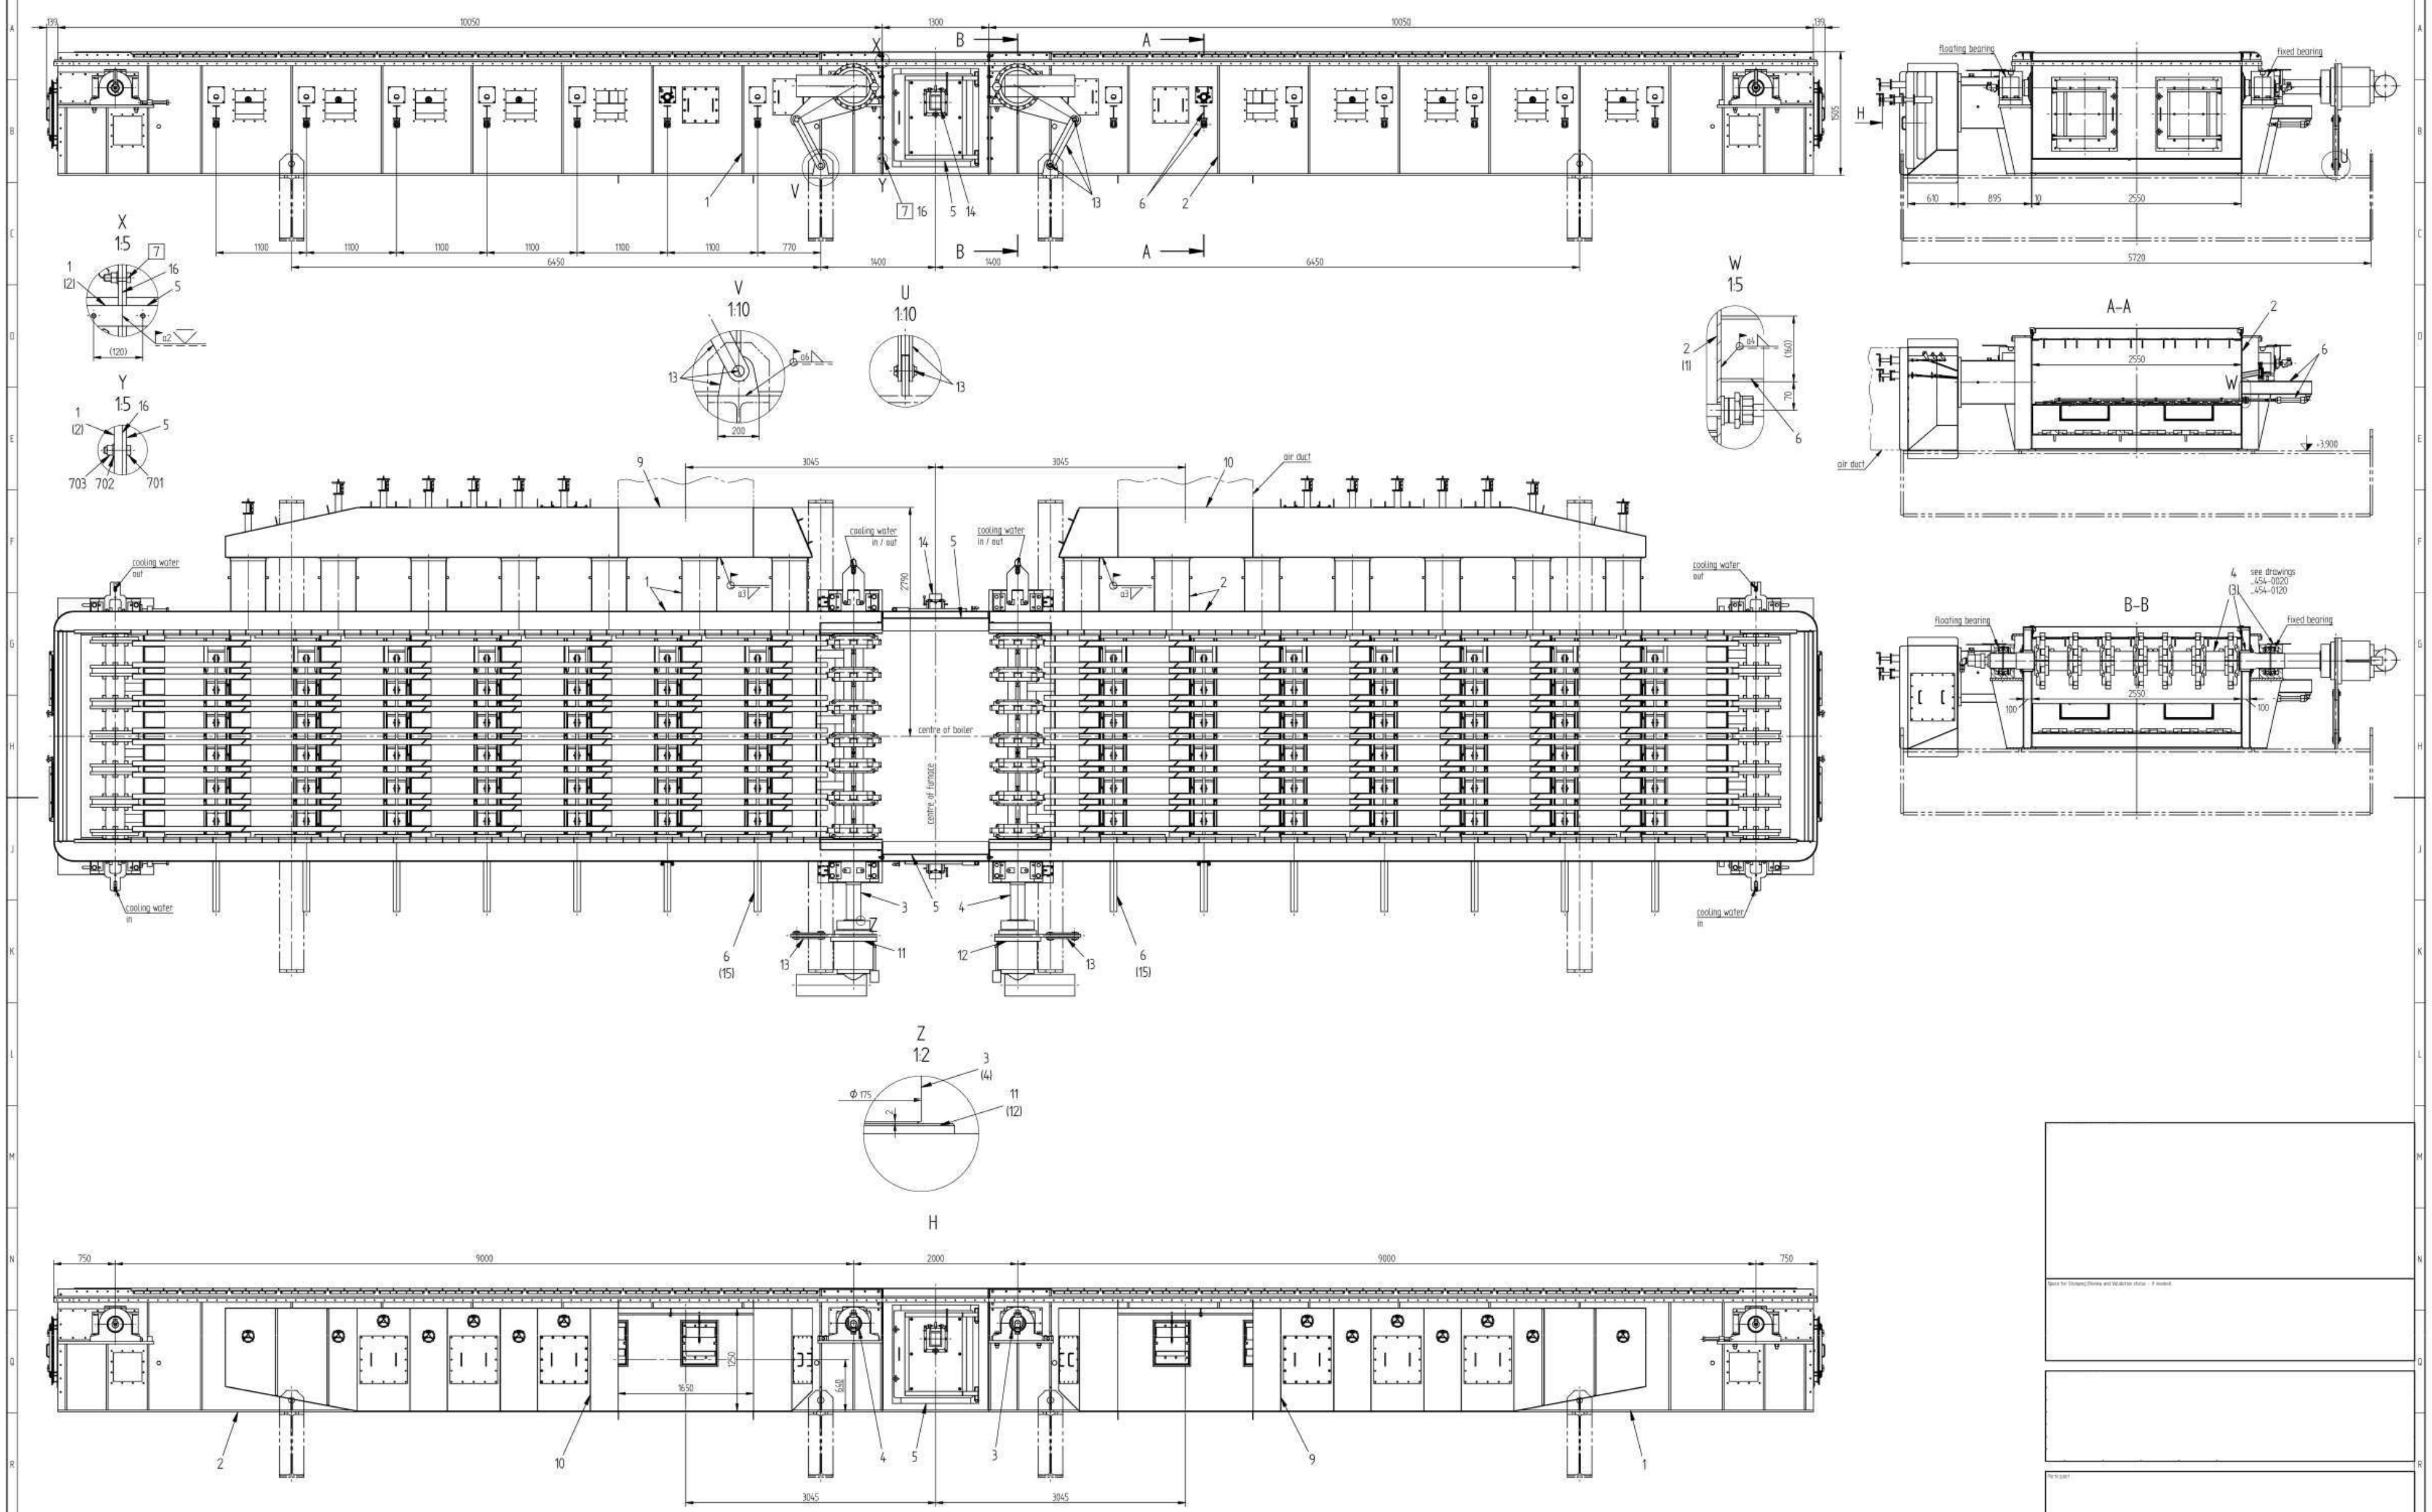
139
10050
1300
10050
139
X
B
A
1505
H
floating bearing
fixed bearing
U
1
V
Y
7
16
5
14
13
6
2
1100
1100
1100
1100
1100
1100
770
6450
1400
1400
6450
610
895
10
2550
5720
X
1:5
1
(2)
16
5
a2
(120)
Y
1:5
1
(2)
16
5
703
702
701
V
1:10
13
a6
200
U
1:10
13
W
1:5
2
(1)
a4
(160)
70
6
A–A
2550
W
air duct
+3,900
9
3045
3045
10
air duct
cooling water
out
cooling water
in / out
cooling water
in / out
14
5
2790
a3
centre of boiler
centre of furnace
cooling water
out
B–B
4
(3)
see drawings
..454-0020
..454-0120
floating bearing
fixed bearing
100
100
cooling water
in
3
5
4
11
12
13
13
6
(15)
6
(15)
cooling water
in
Z
1:2
ϕ 175
2
3
(4)
11
(12)
H
750
9000
2000
9000
750
1250
1650
640
2
10
4
5
3
9
1
3045
3045

Space for Stamping/Review and Validation status – if needed

Participant

Scale 1:25			Other Document Code (if any)
			Format A0
Document Type Equipment detail drawing		Project Document Code ST1/06/B/HHB--00454/00/008	
Title, Subtitle Ash extractor grates		Document Status Released	
		Identification number 14/8315/00 454-0008	
		Rev. 00	Date 25.03.2011	Lang. EN	Sheet 1 / 1

Please consider the environment before printing this document

freigegeben / released