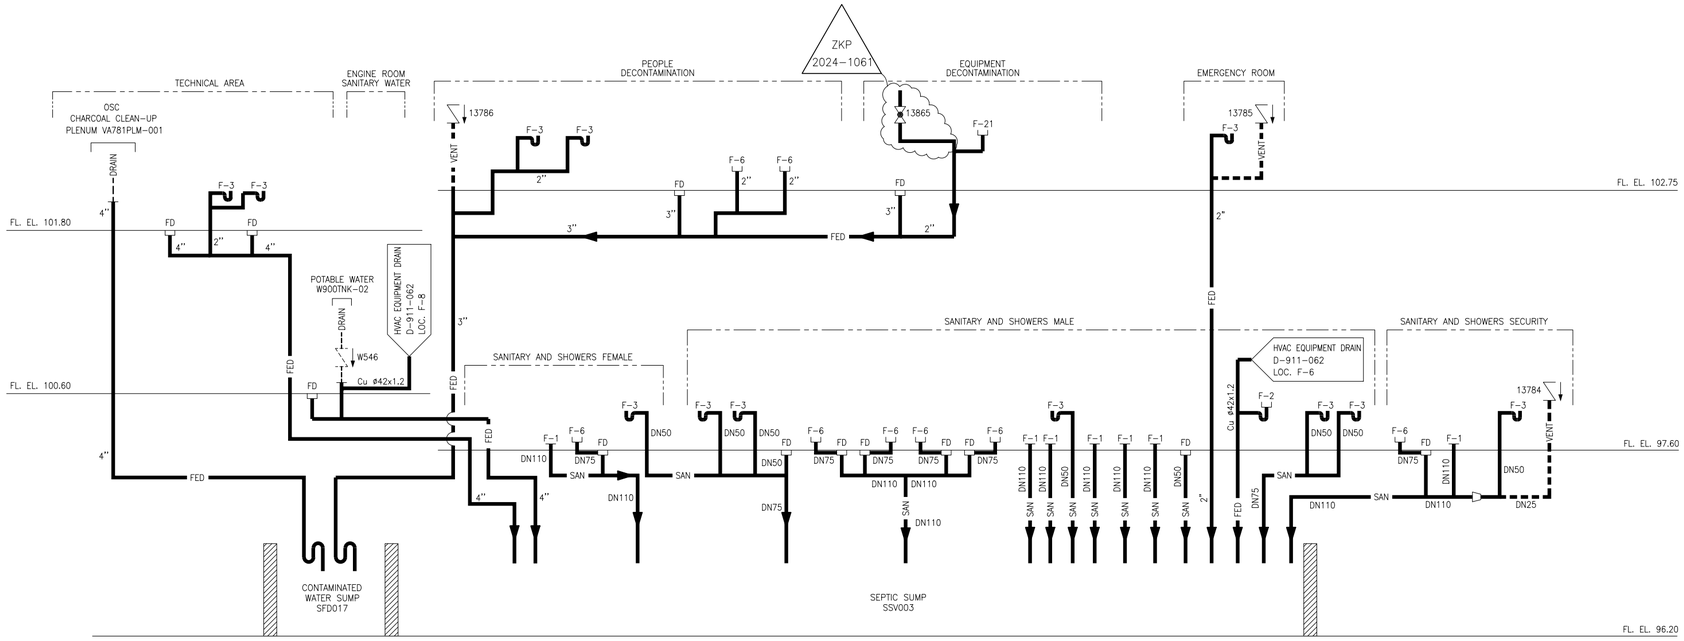

NOTES:

1. FOR FIXTURE SCHEDULE, SEE DRAWING E-921-501.
2. TRANSFER TO RADIOACTIVE WASTE CONTAINER.
3. CONTAMINATED WATER SUMP CONNECTION POINT (FP TYPE C).

ABBREVIATION KEY: –		PIPE LINE SPECIFICATION
FED	– FLOOR AND EQUIPMENT DRAIN PIPE	15D-1
SAN	– SANITARY PIPE	–
VENT	– VENT PIPE	–
FD	– FLOOR DRAIN	–

REFERENCES	FUNCTIONAL DIAGRAM	LOOP DIAGRAM
A	B-802-060	–

REFERENCES	FUNCTIONAL SPECIFICATION	FUNCTIONAL DIAGRAM
1 THRU 3	1056-0575	–

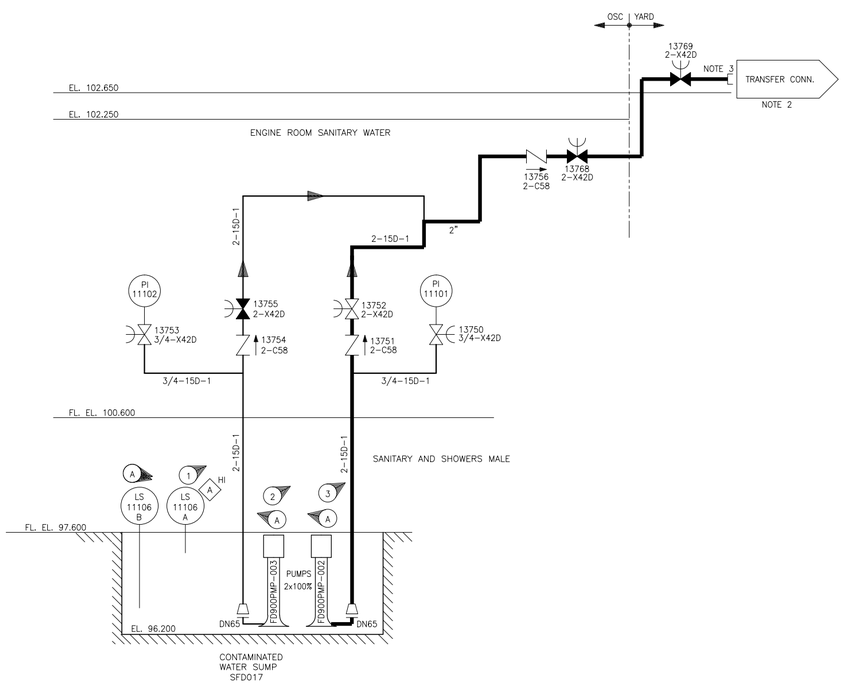

1. Interim Dwg. No.: D-911-061-0-IA
   Interim Sketch No.: N/A
2. Design Mod. No.: ZKP 2024-1061
3. Drawing Rev. No.: 0
4. New Drawing No.: N/A
5. Resp. Eng.: R. MLAKAR Date: 17.09.2025
6. Checker: T. BROMŠE Date: 17.09.2025

ZKP 2024-1061

Original Design Firm: NEK d.o.o.
Replaced Manual Drawing: N/A
Last Revision And Date: N/A

THIS IS A CAD DRAWING AND SHOULD NOT BE REVISED OR MODIFIED MANUALLY

NO.	DATE	BY	REVISION	CKD. BY	LE APPR.
0	22.12.21	K.K.	ISSUED PER MOD 1056-NA-L.	R.P.	R.P.

NUKLEARNA ELEKTRARNA KRSKO
NUCLEAR POWER PLANT KRSKO

FD FLUID SYSTEM DIAGRAM

STATION DRAINAGE & SUMPS DISCHARGE SYSTEM

OSC BUILDING

DESIGN ENGINEERING

NUCLEAR POWER PLANT KRSKO — KRSKO, SLOVENIA

MADE	CHECKED	LE APPROVAL
1. K. KERIČ	2. R. PETAN	3. R. PLANINC

REFERENCE DRAWINGS:

SCALE

DRAWING NUMBER	SYSTEM	SH.NO.	REV.
D-911-061	FD		0

FILE: D9110610 DWG, SPREJEL: _____