2024-1061 Rev. 0 H3-12

ITEM NO.	NO. REQD.	B. M. ITEM	DESCRIPTION	MATERIAL	REF. NOTES
1	1		U80x200mm	NOTE 2	DIN 1026-1
2	2		ANCHOR BOLTS, HILTI HST3 M12x115 40/20	GALVANIZED STEEL	HILTI
3	1	A48	U-BOLT FOR 1" PIPE	GALVANIZED STEEL	DIN 3570

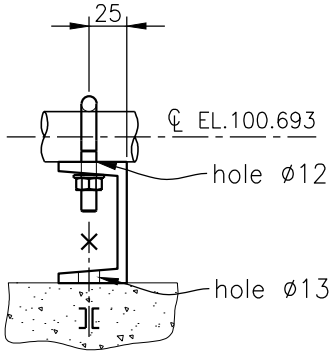

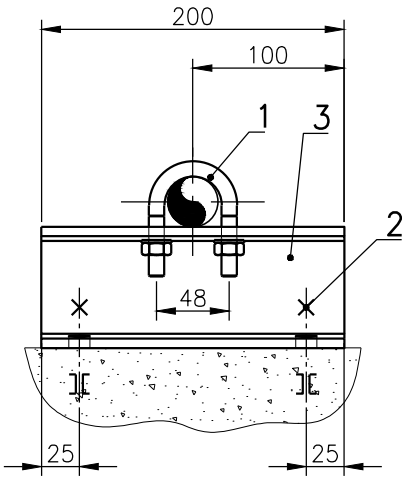



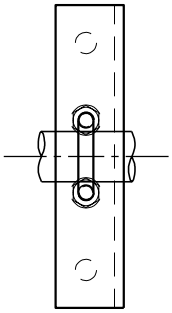

NOTES:

1. ALL DIMENSIONS ARE IN MILIMETERS.
2. MATERIAL GRADE SHALL BE ASTM A36 OR THE EQUIVALENT (S275J2 OR S355J2).
3. SUPPORT SHALL BE SANDBLASTED AND COATED ACCORDING TO NEK PROCEDURE SP-A322.
4. ANCHORING ACCORDING TO HILTI INSTRUCTIONS.
5. THE CUT OF REBARS IS NOT PERMITED. APLLY SCANNING FOR POSITIONING OF THE ANCHOR BOLTS AND ADAPT HOLES' LOCATIONS AS NEEDED.
6. WELDING ACCORDING TO AWS D1.1. FILLET WELD. BUTT WELDS FULL PENETRATING.

ZKP
2024-1061

1. Interim Dwg. No.: SIP-MN034-SUPPORT-003-IA
   Interim Sketch No.: N/A
2. Design Mod. No.: ZKP 2024-1061
3. Drawing Rev. No.: N/A
4. New Drawing No.: SIP-MN034-SUPPORT-003
5. Resp. Eng.: T. BROMŠE Date: 18.07.2025
6. Checker: R. MLAKAR Date: 18.07.2025

NON-SAFETY RELATED

Position ISO 128

Scale NTS

Mass

	Date	By
Made		
Check.		
App.		

Name:

WT SYSTEM
PIPE SUPPORT
OPC BUILDING

Design Firm
SIPRO INŽENIRING CKŽ 135c SI-8270 KRŠKO

Drawing No.
SIP-MN034-SUPPORT-003

Sheet No. 1/1

Format: A3

Rev.	Modification	Date	By

File Name.: SIP-MN034-SUPPORT-003.dwg