

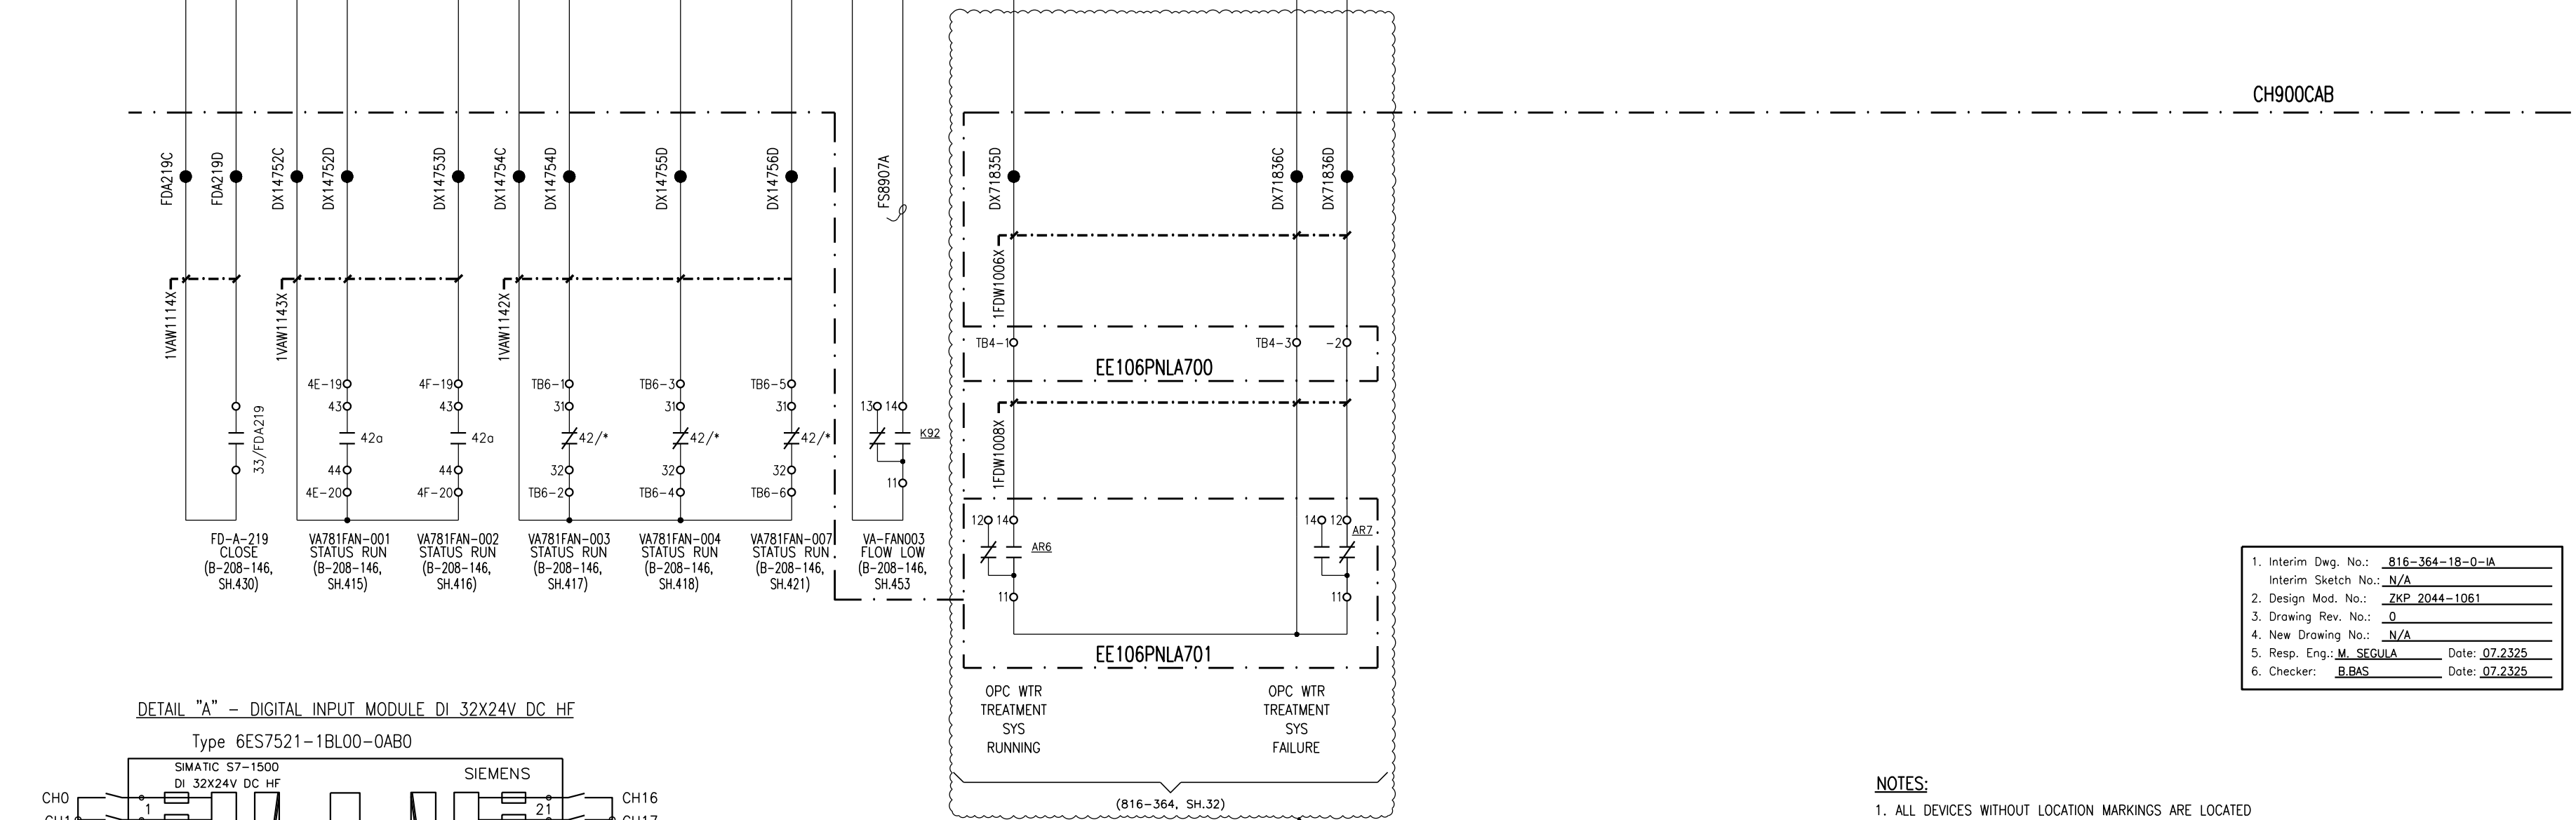
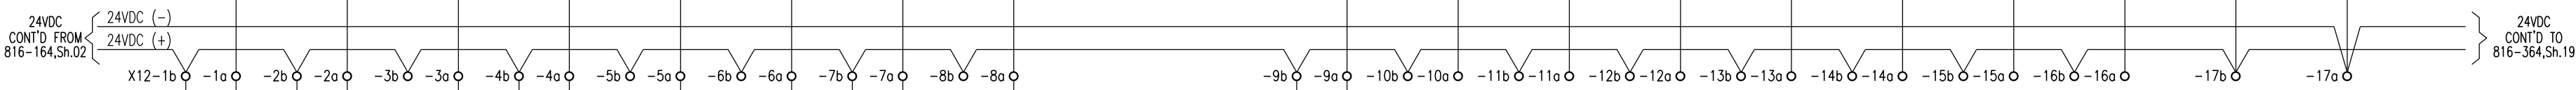


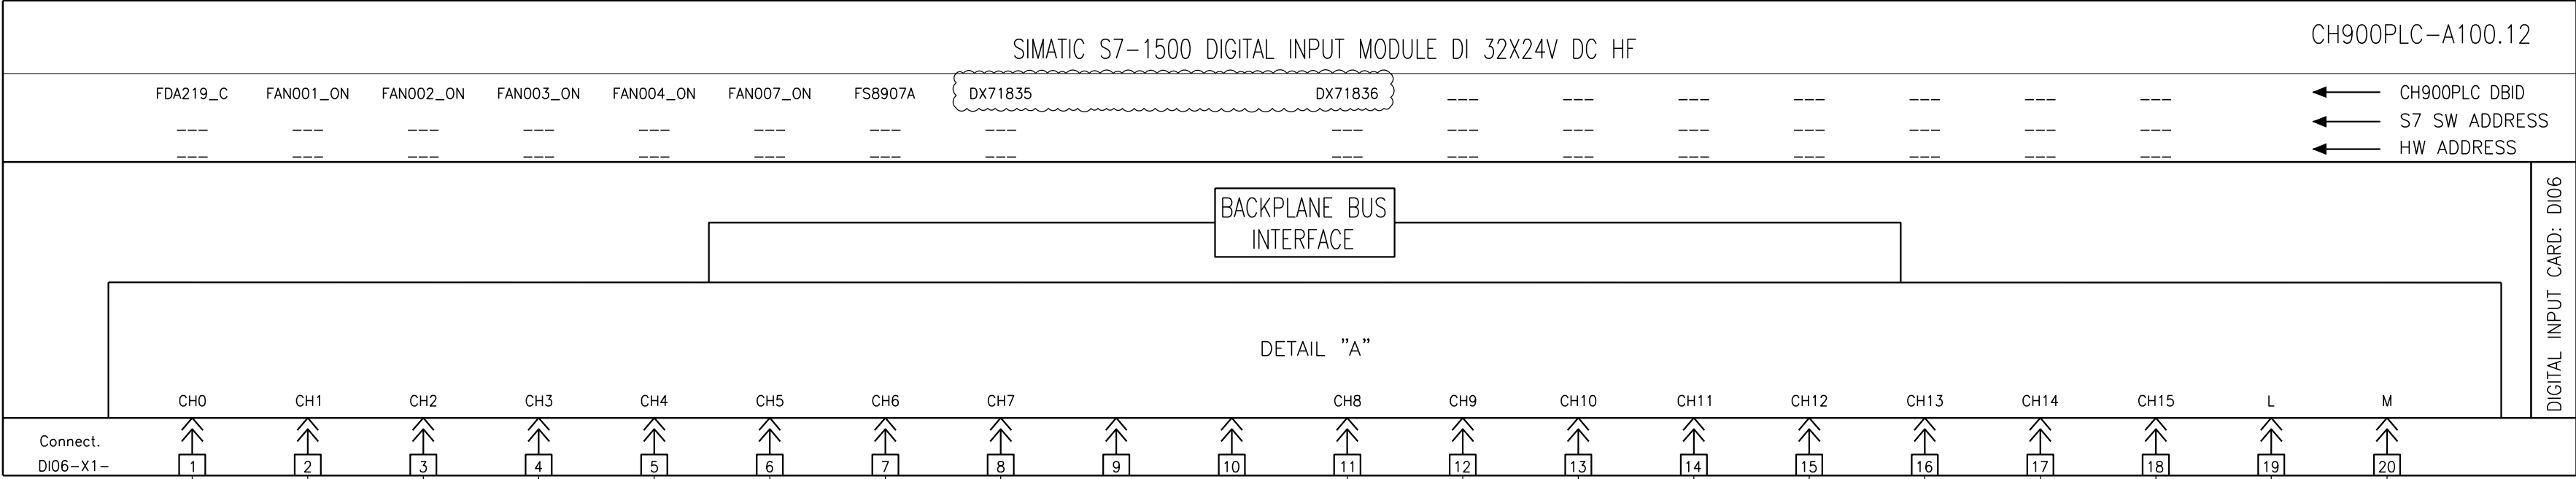

1. Interim Dwg. No.:	816-364-18-0-1A
Interim Sketch No.:	N/A
2. Design Mod. No.:	ZKP 2044-1061
3. Drawing Rev. No.:	0
4. New Drawing No.:	N/A
5. Resp. Eng.:	M. SEGULA Date: 07.2325
6. Checker:	B.BAS Date: 07.2325

DETAIL "A" - DIGITAL INPUT MODULE DI 32X24V DC HF

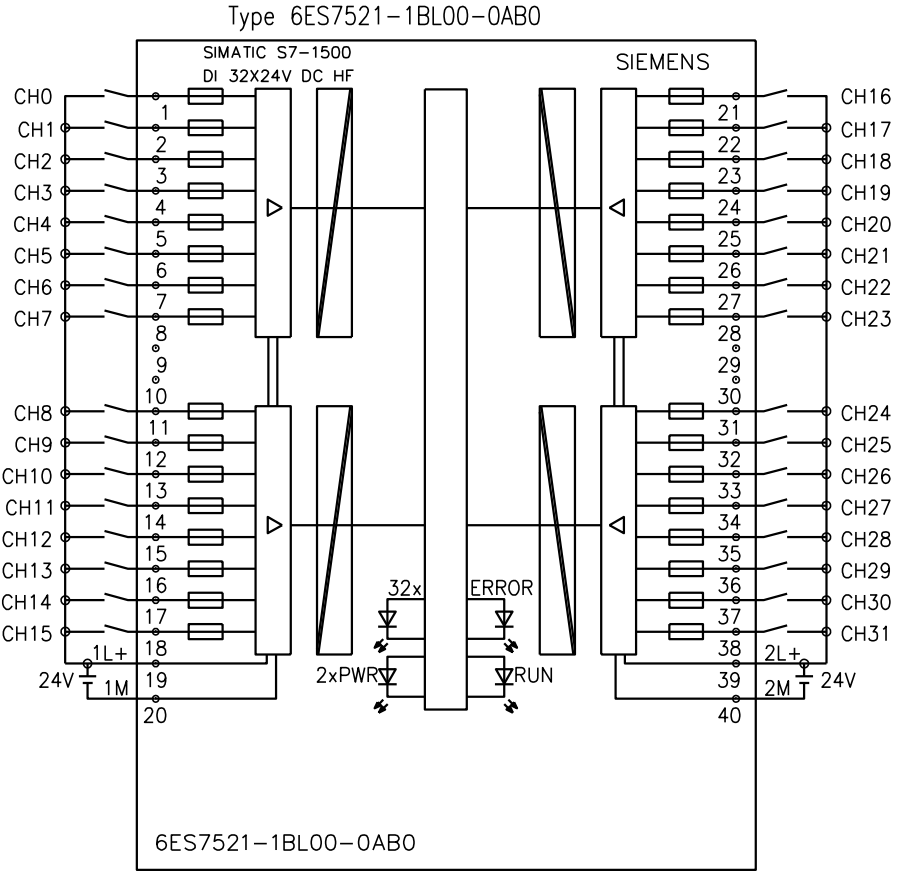

- NOTES:
- ALL DEVICES WITHOUT LOCATION MARKINGS ARE LOCATED IN CABINET CH900CAB.
 - ALL DIGITAL CHANNELS INPUT CIRCUITS HAVE SCHEMATIC AS SHOWN IN DETAIL "A".
 - INTERNAL WIRING

NUKLEARNA ELEKTRARNA KRSKO NUCLEAR POWER PLANT KRSKO		
PROCESS COMPUTER SYSTEMS - PCS		
I/O LOOP WIRING DIAGRAM: OSC MONITORING SYS.		
DIGITAL INPUTS CH900PLC-A100.12 1/2		
DESIGN ENGINEERING		
NUCLEAR POWER PLANT KRSKO		KRSKO, SLOVENIA
MADE	CHECKED	LE APPROVAL
1. IBE	2. R. PETAN	3. D. VEHOVAR
REFERENCE DRAWINGS:		
SCALE	816-364	CH 18 0
DRAWING NUMBER		SYSTEM SH.NO. REV.

Original Design Firm: IBE
Replaced Manual Drawing: N/A
Last Revision And Date: N/A

NO.	DATE	BY	REVISION	CKD. BY	LE APPR.
0	12.08.22	IBE	ISSUED PER MOD 1056-NA-L	R.P.	D.V.