

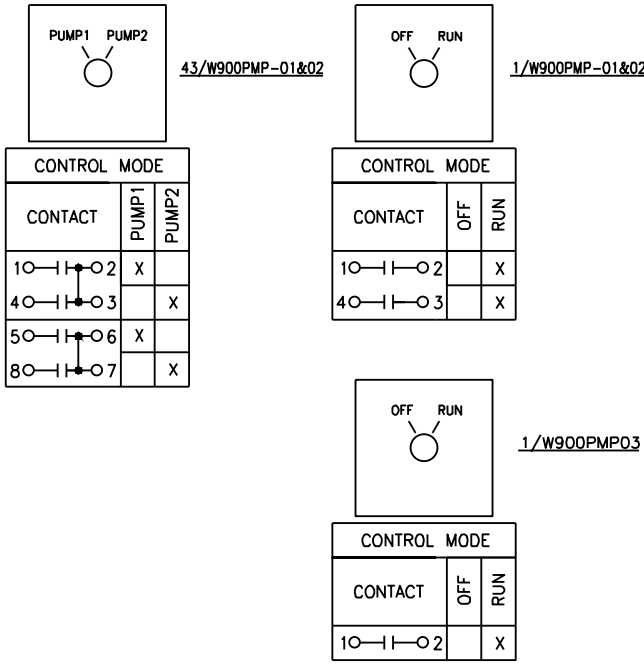
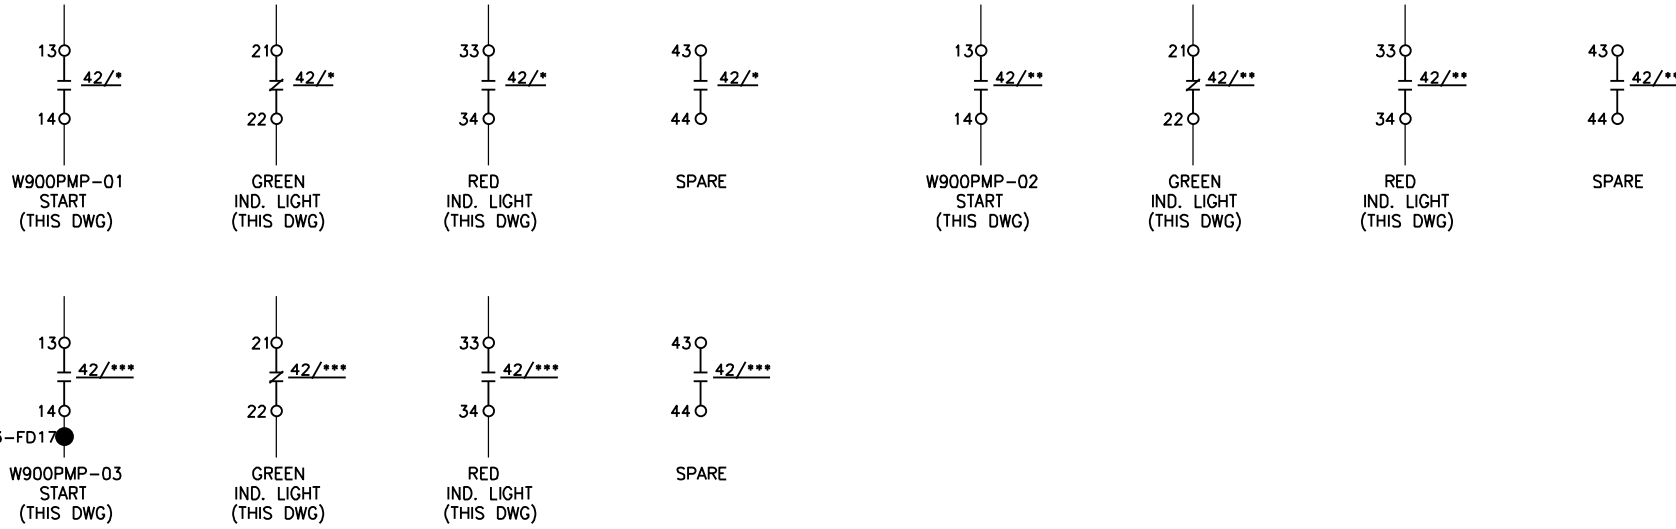


- NOTES:-
- 1. ALL DEVICES WITHOUT LOCATION MARKINGS ARE LOCATED IN EE106PNLA700
 - 2. LOCATION SYMBOLS:
□ LOCALLY MOUNTED
 - 3. * - W900PMP01
** - W900PMP02
*** - W900PMP03
 - 4. LAST USED WIRE NO. 3-FD17

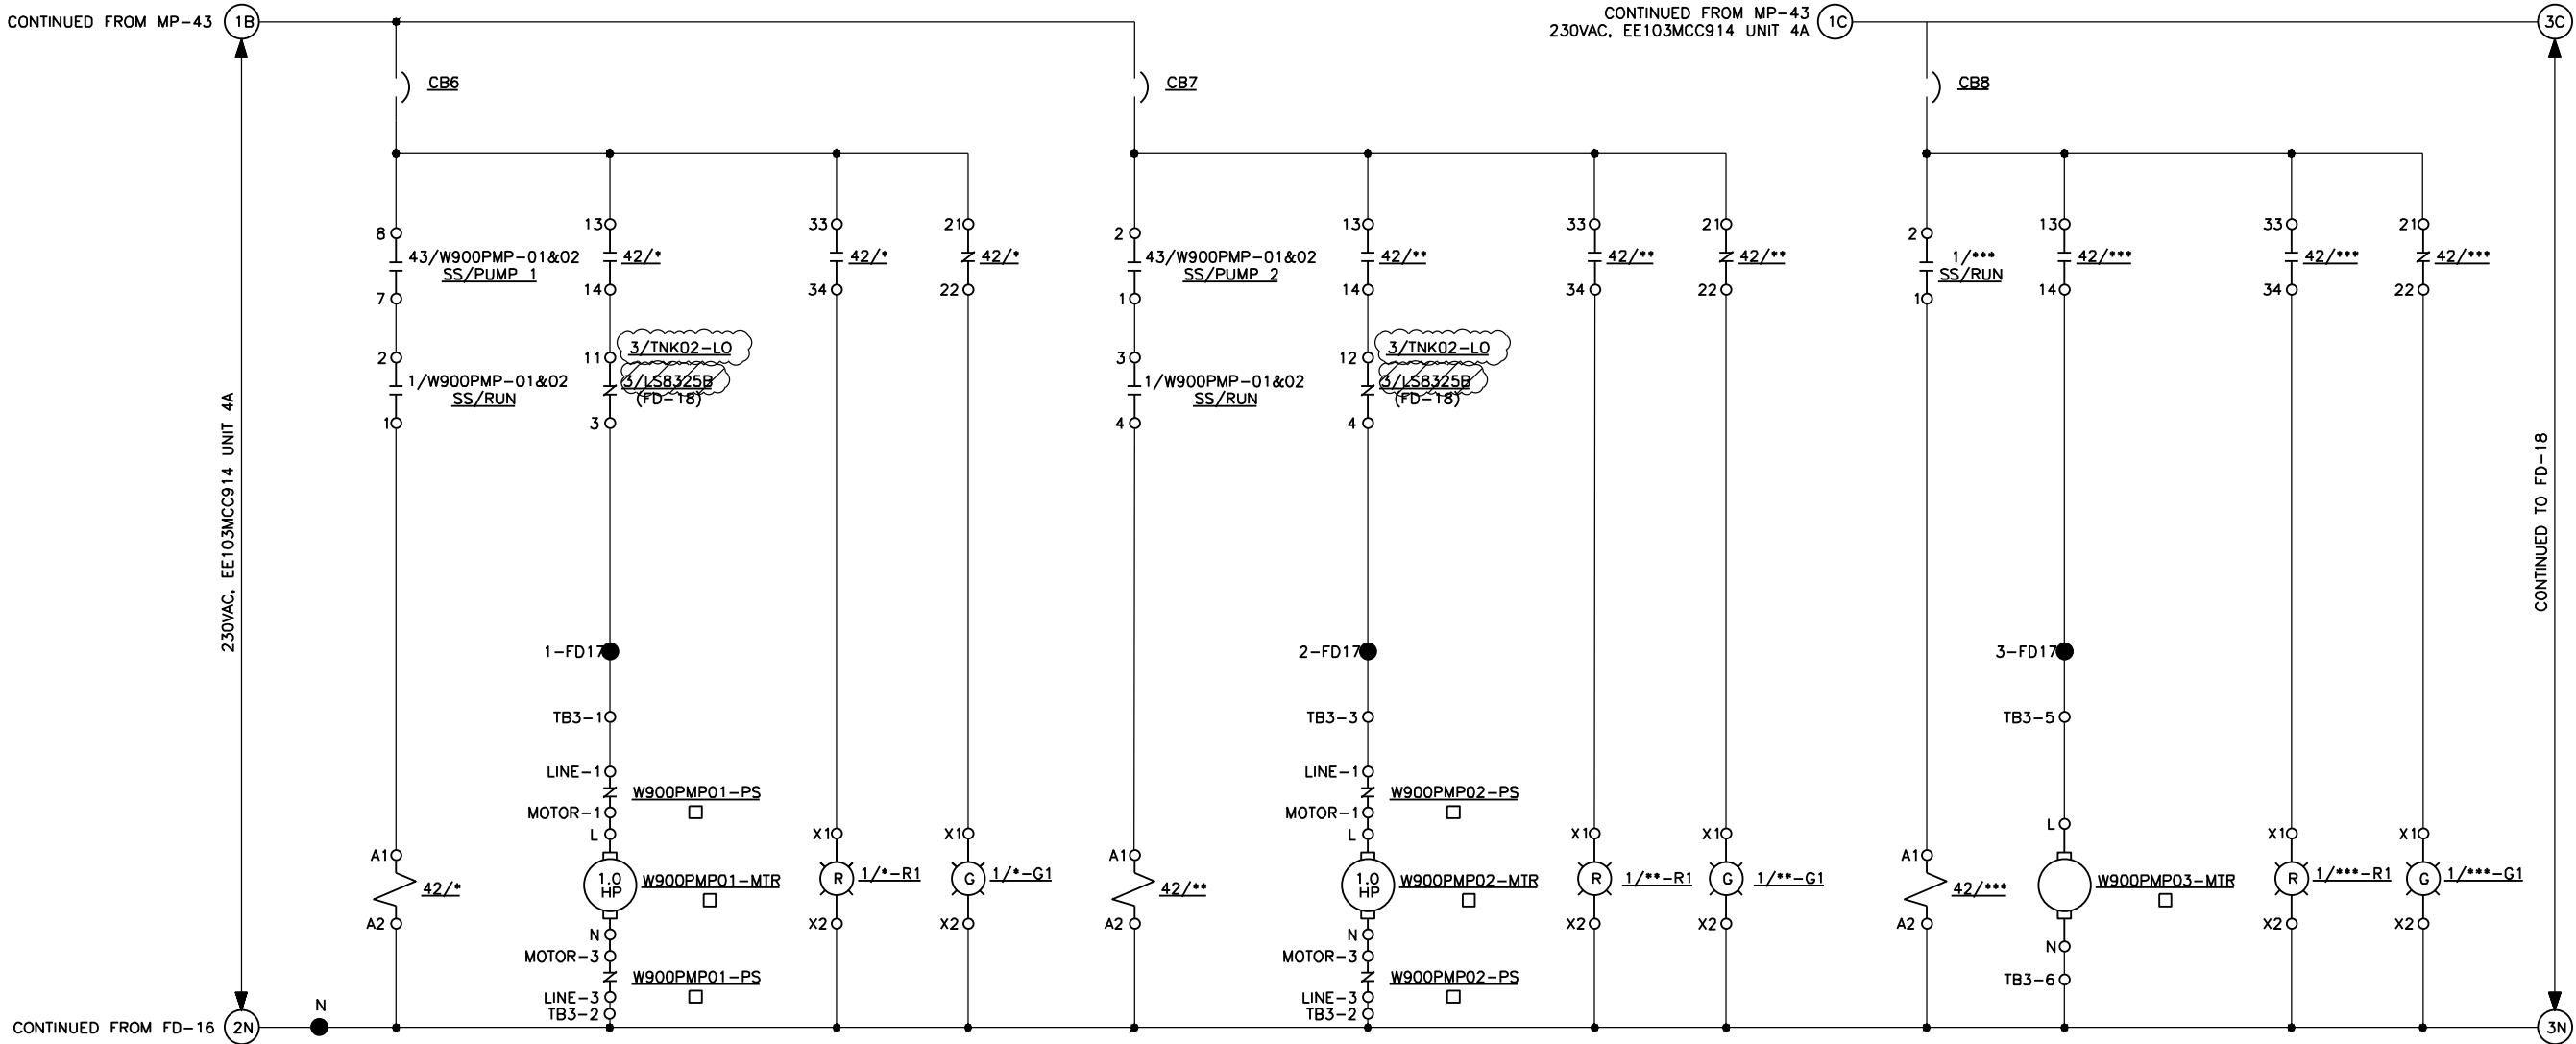

1. Interim Dwg. No.:	B-208-060-17-0-1A
Interim Sketch No.:	N/A
2. Design Mod. No.:	ZKP 2024-1061
3. Drawing Rev. No.:	0
4. New Drawing No.:	N/A
5. Resp. Eng.:	M. SEGUJA Date: 03.2026
6. Checker:	B.BAS Date: 03.2026

Original Design Firm: SIPRO INŽENIRING d.o.o.
Replaced Manual Drawing: N/A
Last Revision And Date: N/A

THIS IS A CAD DRAWING AND SHOULD NOT BE REVISED OR MODIFIED MANUALLY

0	02.2022	P.V.	ISSUED PER 1056-NA-L	R.P.	B.P.
NO.	DATE	BY	REVISION	CKD. BY	LE APPR.

NUKLEARNA ELEKTRARNA KRSKO NUCLEAR POWER PLANT KRSKO		
ELECTRICAL ELEMENTARY – DIAGRAM		
SUMP DISCHARGE SYSTEM		
OSC BLDG WATER PUMPS		
DESIGN ENGINEERING		
MADE		CHECKED
1. P. VINTAR		2. R. PETAN
REFERENCE		3. B. PEVEC
SS-211-060, K-4		
DRAWINGS:		
SCALE	B-208-060	FD 17 0
DRAWING NUMBER		SYSTEM SH.NO. REV.